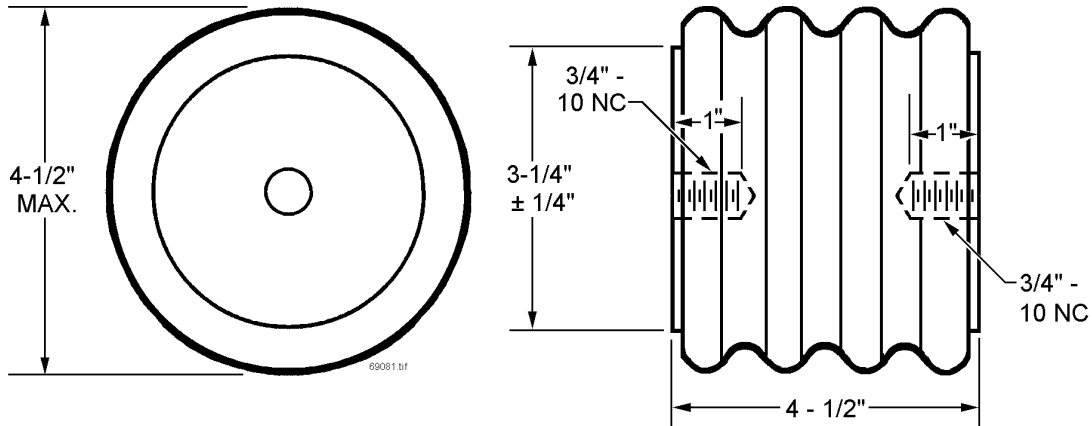


MATERIAL STANDARD**INSULATOR
BUS BAR SUPPORT
UNDERGROUND VAULT**

The insulator shall be of the configuration shown and meet the requirements of the latest revision of ANSI C37.31 tables 1 and 4 for class A indoor insulators. Material shall be composite (not porcelain).

Reference Specifications: ANSI C37.31

Stock Unit: EA

Stock Number	BIL kV	Rating kV	Bending Moment at Base: In-lbs	Torsion In.-Lbs	Tension Lbs	NEMA Class	Approved Manufacturers
							C-K Composites
690856	75	7.5	21,000	6,000	5,000	A-30	16-D-7191 REV. 2

ORIGINATOR

Jim S. Horn

STANDARDS COORDINATOR

Charles L. Shaffer

STANDARDS SUPERVISOR

John C. Hinner

UNIT DIRECTOR

Harold J. J.